

RG-08 : SE-330 NEUTRAL-GROUNDING-RESISTOR MONITOR SETTINGS

SE-330 Model Number: SE-330 - ____ - ____

SE-330 Serial Number: _____ Revision: _____

Substation Identification: _____

Transformer Specifications: _____

SE-330 Communications

Check One	
	Local RS-232
	Other

Current Transformer

Check One	
	EFCT (5-A primary rating when connected to sensitive input)
	SE-CS30 (30-A primary rating when connected to sensitive input)
	Other:

Current Transformer Connection

Check One	
	Sensitive Input (Terminals 8, 11)
	1-A Input (Terminals 9, 11)
	5-A Input (Terminals 10, 11)

Sensing Resistor

Check One	
	ER-600VC
	ER-5KV
	ER-15KV Moisture Resistant Enclosure
	ER-25KV Moisture Resistant Enclosure
	ER-35KV Moisture Resistant Enclosure

Remote Indication

Check One	
	None
	RK-232
	Other:

NGR Ratings

Current: _____ A

Voltage: _____

Time: _____

Resistance: _____

Serial No.: _____

Mfg.: _____

GF Trip Level

Setting: _____ % _____ A

GF Trip Time


Setting: _____ s

VN Trip Level

Setting: _____ V

X 5 for 100 kΩ Sensing Resistor:

RG-08 : SE-330 NEUTRAL-GROUNDING-RESISTOR SETTINGS

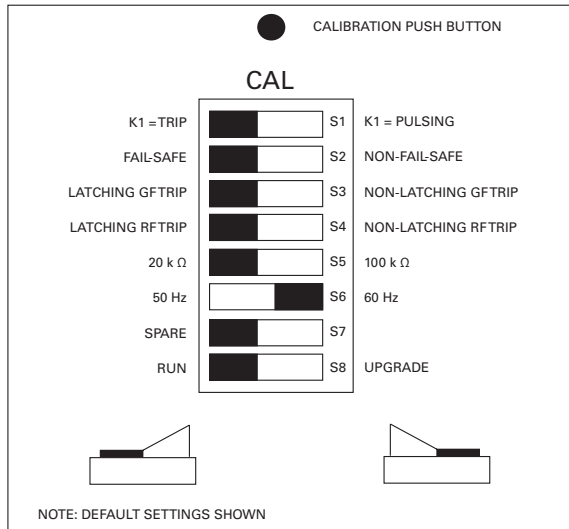

Configuration Switch Settings			
		Check One	Check One
S1:	K1 = Trip		K1 = Pulsing
S2:	Fail-Safe		Non-Fail-Safe
S3:	Latching GF Trip		Non-Latching GF Trip
S4:	Latching RF Trip		Non-Latching RF Trip
S5:	20 k Ω		100 k Ω
S6:	50 Hz		60 Hz
S7:	Not Used		
S8:	Run		Upgrade

System Calibration

Calibration Successful: _____

Date (YYYY-MM-DD): _____

Calibration Number (if available): _____