



TECHNICAL INFORMATION

TITLE: SE-330HV NEUTRAL-GROUNDING-RESISTOR MONITOR SETTINGS

SE-330HV Model Number: SE-330HV - -

SE-330HV Serial Number: _____ **Revision:** _____

SE-330HV Communications: Local RS-232 Other:
Address: _____

Substation Identification: _____

Transformer Specifications: _____

CURRENT TRANSFORMER:

- EFCT (5-A primary rating when connected to sensitive input)
- SE-CS30 (30-A primary rating when connected to sensitive input)
- Other: _____ : _____
- Connection:
 - Sensitive Input (Terminals 8, 11)
 - 1-A Input (Terminals 9, 11)
 - 5-A Input (Terminals 10, 11)

SENSING RESISTOR:

- ER-15KV
- ER-25KV
- ER-35KV
- ER-72KV

NGR RATINGS:

- Current: _____ A
- Voltage: _____ V
- Time: _____
- Resistance: _____ Ω
- Serial No.: _____
- Mfg: _____

REMOTE INDICATION:

- RK-332 None
- Other _____

GF TRIP LEVEL:

Setting: _____ % _____ A

GF TRIP TIME:

Setting: _____ s

VN TRIP LEVEL:


- Setting: _____ V
- X 1 for 100 kΩ Sensing Resistor
- X 2 for 200 kΩ Sensing Resistor

DATE	REV	AUTHOR	DOCUMENT LOCATION	PAGE
2006-Jul-19	0	JG	http://www.startco.ca/library/techinfo/section3/3.15.pdf	1 of 2



TECHNICAL INFORMATION

TITLE: SE-330HV NEUTRAL-GROUNDING-RESISTOR MONITOR SETTINGS

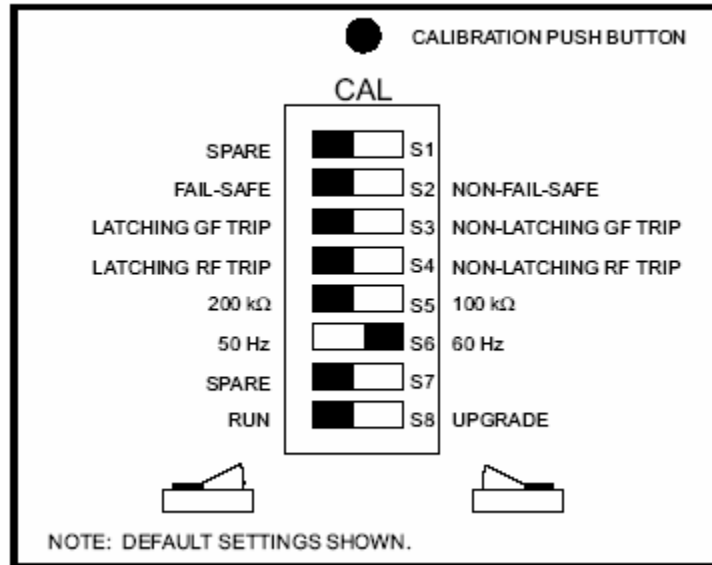

CONFIGURATION SWITCH SETTINGS:

- | | | | |
|----------------------|--------------------------|----------------------|--------------------------|
| S1: SPARE | | | |
| S2: FAIL-SAFE | <input type="checkbox"/> | NON-FAIL-SAFE | <input type="checkbox"/> |
| S3: LATCHING GF TRIP | <input type="checkbox"/> | NON-LATCHING GF TRIP | <input type="checkbox"/> |
| S4: LATCHING RF TRIP | <input type="checkbox"/> | NON-LATCHING RF TRIP | <input type="checkbox"/> |
| S5: 200 KΩ | <input type="checkbox"/> | 100 KΩ | <input type="checkbox"/> |
| S6: 50 Hz | <input type="checkbox"/> | 60 Hz | <input type="checkbox"/> |
| S7: SPARE | | | |
| S8: RUN | <input type="checkbox"/> | UPGRADE | <input type="checkbox"/> |

SYSTEM CALIBRATION:

Calibration Successful

Date (YYYY-MM-DD) _____

Calibration Number (if available) _____

DATE	REV	AUTHOR	DOCUMENT LOCATION	PAGE
2006-Jul-19	0	JG	http://www.startco.ca/library/techinfo/section3/3.15.pdf	2 of 2